

Electric Load Demand Forecasting in Power System

Tianhao Chen

School of Engineering, University of Jinan, Jinan 250022, China

Abstract: In a deregulated power industry, accurate Load Forecasting (LF) is an important key for daily power market. Accordingly, this prediction can help the unit commitment as well as in economic scheduling of the generators. This paper presents a hybrid approach for the LF. Long-term demand forecasting presents the first step in planning and developing future generation, transmission and distribution facilities. One of the primary tasks of an electric utility accurately predicts load demand requirements at all times, especially for long-term. Based on the outcome of such forecasts, utilities coordinate their resources to meet the forecasted demand using a least-cost plan. In general, resource planning is performed subject to numerous uncertainties. This paper presents an overview of the past and current practice in long-term demand forecasting. It introduces methods, which consists of some traditional methods, neural networks, genetic algorithms, fuzzy rules, support vector machines, wavelet networks and expert systems.

Keywords: Load forecasting, Neural networks, Prediction methods.

1 INTRODUCTION

Short Term Load Forecasting (STLF) plays an important role in many of the operations of a power system like unit commitment (UC), economic load dispatch (ELD), hydro thermal scheduling, maintenance scheduling etc. STLF helps the system operator to schedule reserve allocation efficiently and is also useful to power system security. Since the power system is a complicated nonlinear system, precise forecasting of STLF is still a difficult task [1-2].

However, this problem is not an easy task. Electrical load time series has non-stationary behavior. Moreover, it is a dynamic nonlinear input/output mapping function of many exogenous variables (such as weather conditions) in addition to its past values [3]. In deregulated electricity markets, interaction between load demand and electricity price signals and change of energy-use patterns of customers due to the variability of electricity price can further complicate STLF [4]. Importance and complexity of this forecast process motivate many research works on the area.

Time series models such ARMA (Auto-Regressive Moving Average) [5] and modified ARMA [6], nonparametric regression [7], Kalman filter [8], and neural network (NN) [9, 10] have been presented for STLF in the literature. In [11], combination of Fixed-size Least Squares Support Vector Machine (LSSVM) by Nonlinear Autoregressive with Exogenous Variable (ARX-NARX) have been proposed. In [12], a prediction method based on seasonal recurrent SVR with chaotic Artificial Bee Colony (ABC) has been presented. Accurate long-term demand forecasting plays an essential role for electric power system planning. It corresponds to load demand forecasting with lead times enough to plan for long-term maintenance, construction scheduling for developing new generation facilities, purchasing of generating units, developing transmission and distribution systems. The accuracy of the long-term load forecast has significant effect on developing future generation and distribution planning. An expensive overestimation of load demand will result in substantial investment for the construction of excess power facilities, while underestimation will result in customer discontentment. Unfortunately, it is difficult to forecast load demand accurately over a planning period of several years. This fact is due to the uncertain nature of the forecasting process. There are a large number of influential that characterize and directly or indirectly affect the underlying forecasting process; all of them uncertain and uncontrollable [3]. However, neither the accurate amount of needed power nor the preparation for such amounts of power is as easy as it looks, because: (1) long-term load forecasting is always inaccurate (2) peak demand is very much

dependant on temperature (3) some of the necessary data for long-term forecasting including weather condition and economic data are not available, (4) it is very difficult to store electric power with the present technology, (5) it takes several years and requires a great amount of investment to construct new power generation stations and transmission facilities [4]. Therefore, any long-term load demand forecasting, by nature, is inaccurate! Generally, long-term load demand forecasting methods can be classified in to two broad categories: parametric methods and artificial intelligence based methods. The artificial intelligence methods are further classified in to neural networks [1] [2] [4] [8] [10], support vector machines [15], genetic algorithms [14], wavelet networks [12] [13], fuzzy logics [16] and expert system [17] methods. The parametric methods are based on relating load demand to its affecting factors by a mathematical model. The model parameters are estimated using statistical techniques on historical data of load and it's affecting factors. Parametric load forecasting methods can be generally categorized under three approaches: regression methods, time series prediction methods [3]. Traditional statistical load demand forecasting techniques or parametric methods have been used in practice for a long time. These traditional methods can be combined using weighted multi-model forecasting techniques, showing adequate results in practical system. However, these methods cannot properly present the complex nonlinear relationships that exist between the load and a series of factors that influence on it [2].

2 Parametric Methods

The there types of well-known parametric methods are as, trend analysis, end-use modeling and econometric modeling.

2.1 TREND ANALYSIS

Trend analysis extends past rates of electricity demand in to the future, using techniques that range from hand-drawn straight lines to complex computer-produced curves. These extensions constitute the forecast. Trend analysis focuses on past changes or movements in electricity demand and uses them to predict future changes in electricity demand. Usually, there is not much explanation of why demand acts as it does, in the past or in the future. Trending is frequently modified by informed judgment, wherein utility forecasters modify their forecasts based on their knowledge of future developments which might make future electricity demand behave differently than it has in the past [5].

The advantage of trend analysis is that, it is simple, quick and inexpensive to perform [5].

The disadvantage of a trend forecast is that it produces only one result, future electricity demand. It does not help analyze why electricity demand behaves the way it does, and it provides no means to accurately measure how changes in energy prices or government polities influence electricity demand [5].

2.2 END-USE MODELS

The end-use approach directly estimates energy consumption by using extensive information on end users, such as applications, the customer use, their age, sizes of houses, and so on. Statistical information about customers along with dynamics of change is the basis for the forecast [5].

End-use models focus on the various uses of electricity in the residential, commercial, and industrial sector. These models are based on the principle that electricity demand is derived from customer's demand for light, cooling, heating, refrigeration, etc. Thus, end-use models explain energy demand as a function of the number of applications in the market [5].

Ideally, this approach is very accurate. However, it is sensitive to the amount and quality of end-use data. For example, in this method the distribution of equipment age is important for particular types of appliances. End-use forecast requires less historical data but more information about customers and their equipments [5].

This method predicts the energy consumptions. If we want to calculate the load, we have to have the load factor in each sections and different types of energy consumptions and then by load factor we can calculate the load in each section.

The system load factor is defined as follows equation:

$$\text{LoadFactor} = \frac{\text{Average - load demand}}{\text{Peak - load demand}} \quad (1)$$

The disadvantage of end-use analysis is that most end-use models assume a constant relationship between electricity and end-use (electricity per appliance). This might hold for over a few years, but over 10 or 20-year period, energy saving technologies or energy prices will undoubtedly change, and the relationships will not remain constant [6].

2.3 ECONOMETRIC MODELS

The econometric approach combines economic theory and statistical techniques for forecasting electricity demand. The approach estimates the relationship between energy consumption (dependent variables) and factors influencing consumption. The relationships are estimated by the least-square method or time series

methods. One of the options in this framework is to aggregate the econometric approach, when consumption in different sectors (residential, commercial, industrial, etc.) is calculated as a function of weather, economic and other variables, and then estimates are assembled using recent historical data. Integration of the econometric approach in to the end-use approach introduces behavioral components in to the end-use equations [5].

The advantage of econometrics are that it provides detailed information on future levels of electricity demand, why future electricity demand increases, and how electricity demand is affected by all the various factors [6][7].

A disadvantage of econometric forecasting is that in order for an econometric forecast to be accurate, the changes in electricity remain the same in the forecast period as in the past. This assumption, which is called constant elasticity, may be hard to justify especially where very large electricity prices changes, make customers more sensitive to electricity prices.

3. Artificial intelligence based methods

3.1 ARTIFICIAL NEURAL NETWORKS

An artificial neural network (ANN), is a massively parallel distributed processor made up of simple processing units called neurons. The neurons have a natural capability for storing experiential knowledge and making it available for use. Every neural network structure has to undergo a training phase with the available data or patterns. This training / learning phase uses a suitable learning algorithm. The prime objective of the learning algorithm is to modify the synaptic weights of the network in an orderly fashion so as to attain a desired design objective and to increase the accuracy of the learning stage minimizing the error. The working of ANN can be divided in two phases one is training phase and other is recalling phase or testing phase. In training phase both the input pattern and its corresponding target output is supplied to the network. Input is given to the network at input node, the input layer neuron processed the input by using activation function and gives its output. The output from this layer is given as input to the next level neuron, and so on up to the output node. The links connected between neurons are having some weight. These weights are updated by some learning algorithm in training phase till the error between the network output and actual output for that input data set or pattern is minimized. The level of error depends on the learning algorithm, quality of data and type of network [8-10]. In developing a long-term load forecast, the following are some of the degrees of freedom which must be iterated upon with the objective to increase the potential for an accurate load forecast: (1) fraction of the database that will be used for training and testing purpose, (2) transformations to be performed on the historical database, (3) ANNs architecture specifications, (4) optimal stopping point during ANNs training, and, (5) relative weights for use in forecast combination [8].

The design of neural network architecture involves decision making on type, size and number of neural being used [11].

The result of Output ANN is in (2).

$$Y_i = \sum_{i=1}^n W_i X_i \quad (2)$$

Where $i = 1, 2, \dots, n$, X_i is input, and W_i is weight of network and Y_i is one of the ANN's outputs.

The first question to be asked is if an ANN can learn to perform the desire application, and if so what would be the most suitable form of the network. In this section, various aspects of ANNs are analyzed to determine a suitable model. These aspects include the network architecture and method of training. There are three types which can be useful for long-term load demand forecasting: Recurrent neural network (RNN) for forecasting the peak load, feed-forward back propagation (FFBP) for forecasting the annual peak load [10] and radial basis function network.(RBFN) for fast training and better following the peaks and valleys [4].

1) *Recurrent neural network*: Recurrent neural network contains feedback connections, which enable them to encode temporal context internally. This feedback can be external or internal. RNN has be ability to learn patterns from the past records and also to generalize and project the future load patterns for an unseen data [10]. We have different types of RNNs, such as Jordan RNN, Elman RNN and others. Feedback connections in these RNNs are different from network to network. For instance, Jordan RNN has feedback connections from output to input while the Elman RNN has feedback connections from its hidden layer neurons back to its inputs. Additional neurons in input layer, which accept these feedback connections, are called state or context neurons. The role of context neurons in RNN is to get inputs from the upper layer, and after processing send their outputs to the hidden layer together with other plan units. In long-term load demand forecasting, there is strong relationship between the present and next year loads. For this type of problem, Jordan's model of RNN proved to be suitable. However, it should be noted that as the period of target forecast loads becomes longer, the forecast errors might increases relatively [10]. This is why the feed-forward back propagation is used for forecasting loads of longer than 1 year. The Jordan RNN used in most of case study is shown in Fig.1.

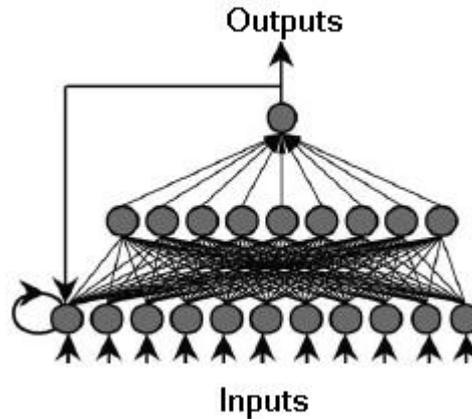


Fig 1. Jordan Recurrent Neural Networks

2) *Feed-forward back propagation*: Feed-forward back propagation is one of the most widely used neural network paradigms, which have been applied successfully in application studies. FFBP can be applied to any problem that requires pattern mapping. Given an input pattern, the network produces an associated output pattern. Its learning and update procedure is intuitively appealing, because it is based on a relatively simple concept: the network is supplied with both a set of patterns to be learned and desired system response for each pattern. If the network gives the wrong answer, then the weights are corrected so that the error is lessened and as a result future responses of the network are more likely to be correct. The advantages of using such a network center on some of their properties, too. Firstly, they automatically generalize their knowledge enabling them to recognize patterns, which they have had seen. Secondly, they are robust enough to recognize patterns, which have been obscured by noise. Lastly, once they have been trained on the initial set of patterns, their recognition of similar patterns is accomplished very quickly [10]. There are two more advantages for FFBP, BP training is mathematically designed to minimize the mean square error across all training patterns and it has supervised training technique [10]. The FFBP used in most of case study is shown in Fig.2.

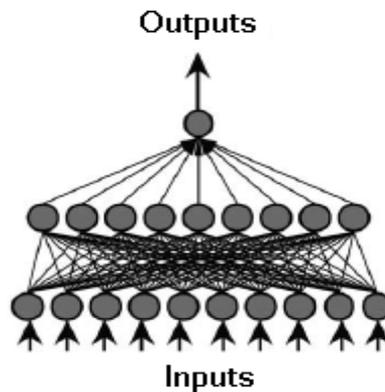


Fig 2. Feed-forward back propagation neural networks

3) *Radial basis function network*: A radial basis function network (RBFN) in most general terms is any network, which has an internal representation of hidden processing elements (pattern units), which are radially symmetric [4]. It consists of three layers; the input layer, hidden layer and output layer. The nodes within each layer are fully connected to the previous layer, as shown in Fig.3.

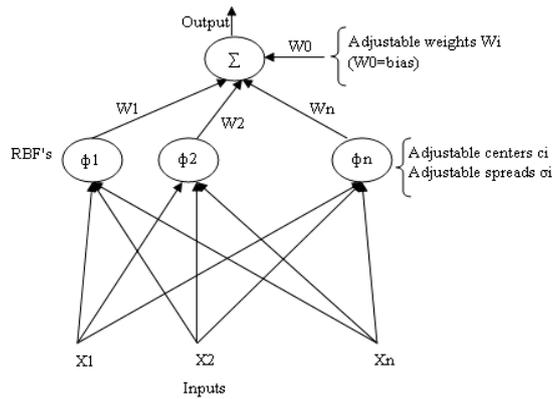


Fig 3. Radial Basis Function Network

For a hidden unit to be radially symmetric, it must have the following three constituents:

- A center, which is a vector in the input space and which is typically stored in the weight vector from the input layer to the pattern unit
- A distance measure, to determine how far an input vector is from the center. Typically, this is the standard Euclidean distance measure.
- A transfer function, which is a function of a single variable, and which determines the output of the processing elements by mapping the output of the distance function. A common function is a Gaussian function, which outputs stronger value when the distance is small. In the other word, the output of a pattern unit is a function of only the distance between an input vector and the stored center.

The key to a successful implementation of these networks is to find suitable centers for the Gaussian function [10].

3.2 WAVELET NETWORKS

Wavelet transform (WT) provides time frequency information of a signal simultaneously. It is the advantage of WT over the Fourier Transform (FT), which only yields the frequency information. Short Time Fourier Transforms (STFT) is an alternative to FT to obtain time information along with the frequency information, but the choice of the window width plays an important role in obtaining a good trade-off between the time and frequency information. Hence, WT is basically used to obtain a better time – frequency information and is extensively used for analyzing the non-stationary signals. WT as the name suggests, uses some small wave like function to analyze a signal and hence called wavelets. Wavelets represent the signal in more useful form. This representation of signal called the wavelet transform. Wavelet moved to various location of a signal and stretched and squeezed to give time and frequency information of that signal. Mathematically wavelet transform is the convolution of wavelet function and the signal. There are different types of wavelets used for analyzing the non-stationary time series data [13-15]. The use of wavelets for an particular application depends on nature of signal and what information we want to extract from that signal. WT are of two types continuous wavelet transform (CWT) and discrete wavelet transform (DWT). In CWT, the signals are analyzed using a set of basis functions which relate to each other by simple scaling and translation. Several papers investigated the application of wavelet analysis in power load forecasting, and the forecasting accuracy was improved. The wavelet network must have the following measurements to forecast well:

- Select proper wavelet function for load forecasting. The selection of wavelet function is important for wavelet application, but there is no general rule till now. Generally, the most important thing of power load forecasting is to improve forecasting accuracy, so it requires less distortion during the wavelet decomposition and reconstruction process, which is different from other applications such as fault detection. Among various wavelet functions, the biorhogonal wavelet function is symmetrical and has linear phase, so it won't bring signal distortion during the decomposition and reconstruction process. Therefore, the selection of biorhogonal wavelet for power load forecasting is suitable [12].
- Avoid border distortion during wavelet transform. Because of the limited number of data in wavelet applications, border distortion problem arises during the wavelet decomposition process, but users often ignore it except the method proposed in [13]. For load forecasting application with finite number of load data, border distortion means the wavelet coefficients of the latest data is distorted and the forecasting based on these coefficients couldn't give accurate forecasting result. It is too bad to forecast without the help of the latest data. To deal with the problem, border extension is a simple and effective solution, and there are several types of border extension, such as symmetrical extension and zero padding. Although it is hard to give general guidelines for selecting proper extension method, symmetrical border extension is suitable for biorhogonal wavelet which is symmetrical.

The structure of the wavelet network is shown in Fig.4.

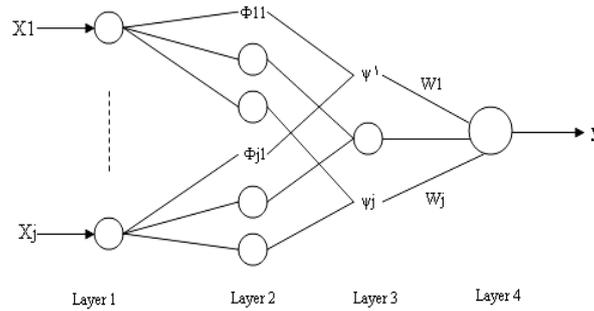


Fig 4. Schematic of Wavelet Network

This structure is very similar to Multi layer neural network.

The most advantage factor of wavelet network is not spanned inputs although the accuracy of model is better than multi layer neural networks. It has more advantages to apply to long-term forecast. The multi-resolution analysis capability of wavelet functions has much power in function approximation to obtain better accuracy [13].

3.3 GENETIC ALGORITHMS

Genetic Algorithms (GAs) have recently received much attention as robust stochastic search algorithms for various problems. This class of methods is based on the mechanism of natural selection and natural genetics, which combines the notion of survival of the fittest, random and yet structured, search and parallel evaluation of the points in the search space. GAs have been successfully applied in various areas such as, load flow problems, fault detection, stability analysis, economic dispatch, power system control and load demand forecasting [14].

Genetic algorithms are a numerical optimization technique. More specifically, they are parameter search procedures based upon the mechanics of natural genetics.

They combine a Darwinian survival-of-the-fittest strategy with a random, yet structured information exchange among a population of artificial “chromosomes”. This technique has gained popularity in recent years as a robust optimization tool for a variety of problems in engineering, science, economics, finance, etc. GAs accommodate all the facets of soft computing, namely uncertainty, imprecision, non-linearity, and robustness. Some of the attractive features can be summarized as following [14]:

- Learning: GAs are the best known and widely used global search techniques with an ability to explore and exploit a given operating space using available performance (or learning) measures.
- Generic Code Structure: GA operates on an encoded parameter string and not directly on the parameters. This enables the user to treat any aspect of the problem as an optimizable variable.
- Optimality of the Solutions: In many problems, there is no guarantee of smoothness. Traditional search techniques often fail miserably on such search spaces. GA is known to be capable of finding near optimal solutions in complex search spaces.
- Advanced Operators: This includes techniques such as nicking (for discovering multiple solutions), combinations of Neural, Fuzzy, and chaos theory, and multiple-objective optimization.

The GAs approach presented in this work is employed to find the optimum values of the state vector \$X\$ that minimizes the absolute summation of the forecasting error \$r(t)\$. In order to emphasize the “best” string and speed up convergence of the iteration procedure, fitness is normalized into range between 0 and 1. The fitness function (ff) adopted is [14]:

$$ff = \frac{1}{1 + k \sum_{k=1}^m |r(t)|} \quad (3)$$

Where \$k\$ is a scaling constant (for example, \$k=0.0001\$) Like other stochastic methods, the GA has a number of parameters that must be selected, size of population, probability of crossover and probability of mutation. \$r(t)\$ is the error vector associated. GA tries to keep the \$r(t)\$ in the allowed limitation. If the \$r(t)\$ is kept in the allowed limitation, the fitness function has the best value fore load demand forecasting [14].

Forecasting results using GA were found to be the best. This indicates that the GA approaches is quite promising and deserves serious attention because of its robustness and suitability for parallel implementation [14].

With \$r(t)\$, we can calculate the load demand forecasting by the following equation:

$$P(t) = a_0 + \sum_{i=1}^n a_i t^i + r(t) \quad (4)$$

Where $P(t)$ is the peak load demand at time t , a_0 , a_i are the regression coefficients relating the load demand $P(t)$ to the time t . $r(t)$ is the residual load at year (t) .

Support Vector Machine (SVM)

SVM (Support Vector Machine) is a useful technique for data classification. Even though people consider that it is easier to use than Neural Networks, however, users who are not familiar with SVM often get unsatisfactory results at first [15].

The support vector machines (SVMs) are based on the principle of structural risk minimization (SRM) rather than the principle of empirical risk minimization, which conducted by most of traditional neural network models. SVMs have been extended to solve nonlinear regression estimation problems [16]. Recurrent neural network (RNN) is one kind of SVM which is based on the main concept in which every unit is considered as an output of the network and the provision of adjusted information as input in a training process. RNNs are extensively applied in long-term load time series forecasting and can be classified in three types, Jordan networks, Elman networks, and Williams and Zipser networks. Both Jordan and Elman networks use mainly past information to capture detailed information. Williams and Zipser networks take much more information from the hidden layer and back into themselves. Therefore, Williams and Zipser networks are sensitive when models are implemented. Jordan and Elman networks are suited to time series forecasting. Traditionally, RNNs are trained by back-propagation algorithms. SVMs with genetic algorithms are used to determine the weights between nodes [16].

The basic concept of the SVM regression is to map nonlinearly the original data x into a higher dimensional feature space. Hence, given a set of data $G = \{(x_i, a_i)\}_{i=1}^N$ (where x_i is the input vector, a_i the actual value and N is the total number of data patterns), the SVM regression function is:

$$f = g(x) = w_i \psi_i(x) + b \tag{5}$$

Where $\psi_i(x)$ is the feature of inputs, and both w_i and b are coefficients. The coefficients (w_i and b) are estimated by minimizing the following regularized risk function:

$$r(C) = C \frac{1}{N} \sum_{i=1}^N \Gamma_{\epsilon}(a_i, f_i) + \frac{1}{2} \|w\|^2 \tag{6}$$

Where,

$$\Gamma_{\epsilon}(a, f) = \begin{cases} 0 & \text{if } |a - f| \leq \epsilon \\ |a - f| - \epsilon & \text{otherwise} \end{cases} \tag{7}$$

And C and ϵ are prescribed parameters. In (6), $\Gamma_{\epsilon}(a, f)$ is called the ϵ -insensitive loss function. The loss equals zero if the forecasted value is within the ϵ -tube (7). The second term, $1/2 \|w\|^2$, measures the flatness of the function. Therefore, C is considered to specify the trade-off between the empirical risk and the model flatness. Both C and ϵ are user-determined parameters.

The architecture of SVMs with genetic algorithm (SVMG) is shown in Fig.5.

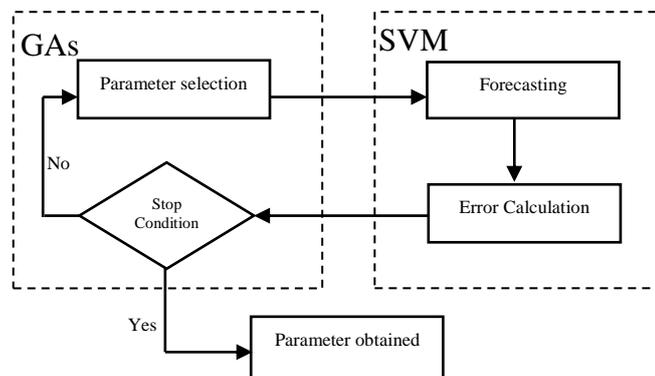


Fig 5. Architecture of SVMG

The superior performance of the RSVMG model has several causes. First, the RSVMG model has nonlinear mapping capabilities and thus can more easily capture electricity load data patterns than can the ANN and regression models. Second, improper determining of these three parameters will cause either over-fitting or under-fitting of a SVM model. In this section, the Gas can determine suitable parameters to forecast electricity load. Third, the RSVMG model performs structural risk minimization rather than minimizing the training errors. Minimizing the upper bound on the generalization error improves the generalization performance compared to the ANN and regression models.

3.4 FUZZY LOGIC MODEL

Fuzzy control systems are rule-based systems in which a set of so-called fuzzy rules represents a control decision mechanism to adjust the effects of certain stimulus. The aim of fuzzy control systems is normally to replace a skilled human operator with a fuzzy rule-based system. The fuzzy logic model provides an algorithm, which can convert the linguistic strategy based on expert knowledge into an automatic strategy. Fig. 6 represents the basic configuration of a fuzzy logic system, which consists of a fuzzification, knowledge base, fuzzy interface and a defuzzification (IO). The fuzzy logic method is applied for scoring. The application of fuzzy rules will improve the model accuracy by avoiding arbitrariness for the purpose of the stud. The fuzzy rule base is composed of some rules generated from the analysis of the historical load data [16].

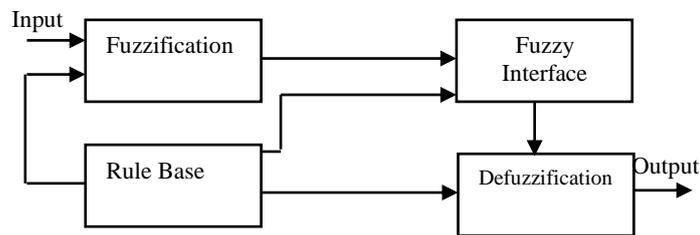


Fig 6. Block diagram of the fuzzy logic system

One of the applications of the fuzzy rules is to combine them with neural network to train ANN and have a better load demand forecasting. The training patterns for the ANN models were collected from the historical load data. The number of training cycles has been determined through a trial process, to avoid overtraining [16].

The benefit of the proposed hybrid structure was to utilize the advantages of both, i.e., the generalization capability of ANN and the ability of fuzzy inference for handling and formalizing the experience and knowledge of the forecasters. It has been demonstrated that the method give relatively accurate load forecasts for the actual data. The test results showed that this method of forecasting could provide a considerable improvement of the forecasting accuracy. This indicates that the fuzzy rules and the training patterns for the ANN is quite promising and deserve serious attention of its robustness and suitability for implementation. It can be concluded that the outcome of the study clearly indicates that the proposed composite model can be used as an attractive and effective means for the industrial load forecasting. The improvement of forecast accuracy and the adaptation to the change of customers would fulfill the forecasting needs [16].

Fig.7. is shown the structure of ANN and Fuzzy based used in forecasting.

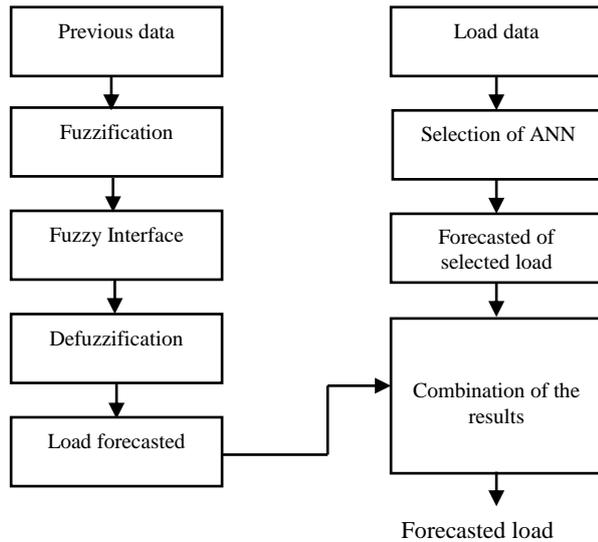


Fig 7. Structure of ANN and Fuzzy based used

3.5 Expert system

The confidence levels associated with classical forecasting techniques, when applied to forecasting problem in mature and stable utilities are unlikely to be similar to those of dynamic and fast growing utilities. This is attributed to the differences in the nature of growth, socio-economic conditions, occurrence of special events, extreme climatic conditions, and the competition in generation due to the deregulation of the electricity sector with possible changes in tariff structures. Under such conditions, these forecasting techniques are insufficient to establish demand forecast for long-term load demand. Consequently, this case requires separate consideration either by pursuing the search for more improvement in the existing forecasting techniques or establishing another approach to address the forecasting problem of such systems [17].

In this section, the classical forecasting methods are firstly applied to obtain the long-term load demand forecasts, for a typical fast growing utility as well as normal developing system [17].

A poor performance is observed when such methods are applied to fast developing system, whereas most of these models are valid when used to produce the forecasts of the normal developing system. Consequently, an extended logistic model is developed to reflect the critical forecasting problem in fast growing areas. Although the developed model gives an accurate load demand forecast compared with the classical models, it is hardly difficult to dependent on single method for producing the demand of such fast growing and dynamic system [17]. This is because several important factors related to the cyclic and dynamic events that contribute significantly to the system load are difficult to involve it into the existing forecasting models.

Thus, there is a need to develop a computational tool which allows one to store the knowledge associated with this problem along with the mathematical models to support the choice of the most suitable load forecasting model, for long-term power system planning. Therefore, the implementation of long-term forecasting strategies using a knowledge-based expert system (ES) is then presented in this section. In the expert system, key system variables which have major effects on system load are identified based on past planners experiences. A set of decision rules relating these variables are then established and stored in the knowledge base to select the recommended forecasting [17].

The main components of the proposed expert system are shown in Fig. 8.

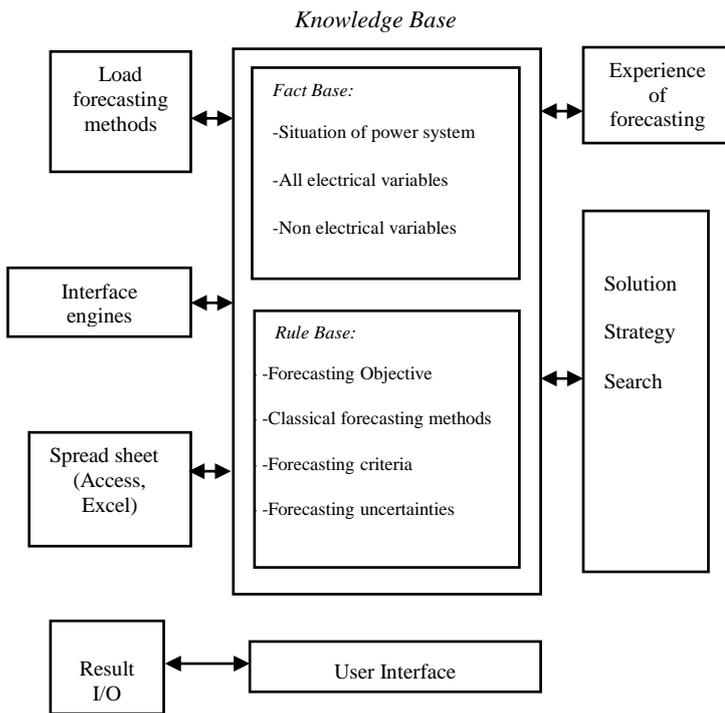


Fig 8. Structure of expert system for long-term load forecasting

Fig 9.

With the knowledge base at hand (rules and facts), an inference engine can be used to search through this knowledge base according to the solution strategy. The detailed procedures of the solution strategy to ascertain the accuracy and credibility of selecting forecasting method. In addition to knowledge base, inference engine, solution strategy, a user interface is also developed in the expert system to facilitate the navigation between the expert system and the user.

The variables of the formulated problem can be grouped into Static and Dynamic Facts as follows:

Static Facts: This kind of knowledge is developed before starting the planning process. A sample of these facts is: system conditions to identify the current situation of the system, i.e., mature, or under developing, isolated or interconnected with other system, etc.

Forecasting horizon to define the load forecasting period, i.e., long-term.

- Load pattern to describe the load behavior (stable, or dynamic pattern, cyclic, or seasonal pattern, or combination of all, time of system peak, load types, etc.)
- Historical peak load to indicate annual and seasonal growth, coincidence factor, area peak, etc.
- Historical energy to describe the information related to number of consumers of each sector, consumption rate, tariff rate, etc.
- Major factors affecting the system peak, i.e., weather variables, economic variables, demographic variables, special event, suppressed demand, bulk loads to be connected into the network, coincidence factor of the system peak, etc.

Dynamic Facts: These facts are developed and automatically updated during the inference process to represent the planning attributes needed for evaluating a decision making process. Samples of these facts include the following:

- load and energy attribute for the estimated load and energy forecast;
- System losses attribute for the estimated system losses;
- Error attribute related to the forecasting model.

In this section, a long-term load forecasting is developed and classified according to the forecasting problem using a knowledge-based expert system (ES). The proposed methodology is applied successfully to forecast yearly peak load for normal and fast developing power systems. Since the expert system is very flexible in updating the forecasting methods and heuristic rules, it is expected that the expert system can serve as a valuable assistant to system planners in performing their annual load forecasting duties. Finally, it can be expected to serve as a valuable assistant also for training purposes [17].

4. CONCLUSIONS

Load forecasting plays a dominant part in the economic optimization and secure operation of electric power systems.

Long-term load forecasting represents the first step in developing future generation, transmission, and distribution facilities. Any substantial deviation in the forecast, particularly under the new market structure, will result in either overbuilding of supply facilities, or curtailment of customer demand. The confidence levels associated with classical forecasting techniques, when applied to forecasting problem in mature and stable utilities are unlikely to be similar to those of dynamic and fast growing utilities. This is attributed to the differences in the nature of growth, socio-economic conditions, occurrence of special events, extreme climatic conditions, and the competition in generation due to the deregulation of the electricity sector with possible changes in tariff structures. Under such conditions, these forecasting techniques are insufficient to establish demand forecast for long-term power system planning. Consequently, this case requires separate consideration either by pursuing the search for more improvement in the existing forecasting techniques or establishing another approach to address the forecasting problem of such systems.

Different methods of long-term load demand forecasting are defined in this paper. All of these methods can forecast the load of the power system, but the amount of previous data and such variables which they need to forecast, make them different in accuracy from area to area.

Finally, for long-term load forecasting, we should know the power system in details, and after that we can select the best method for the specified power system. Sometimes we can combine different methods and compare the accuracy of them together.

Traditional methods, such as time series, regression models and etc. are used in most of the countries, because of their reliable result.

Neural networks can solve nonlinear problems, and because of nonlinear behavior of load, so they can be useful for long-term load forecasting.

Genetic algorithm can forecast long-term load forecasting, when we have a lot amount of different variables and we want to find the best solution to follow the future load. Also it can be useful to estimate the support vector machine parameters.

Wavelet can estimate peak and valley of load behavior better than Furious series. It can combine with ANN have a better forecast.

REFERENCES

1. Razmjoo, N., & Ramezani, M. (2019). Interval structure of Runge-Kutta methods for solving optimal control problems with uncertainties. *Computational Methods for Differential Equations*, 7(2), 235-251.
2. Seyyedeh Zeinab Fatemi Mostafa Shamsi Navid Razmjoo. "Collocation method for differential variational inequality problems", *International Journal of Numerical Modelling: Electronic Networks, Devices and Fields*, <https://doi.org/10.1002/jnm.2466>.
3. Mohammad Makaremi, Navid Razmjoo, Mehdi Ramezani. "A new method for detecting texture defects based on modified local binary pattern," *Signal, Image and Video Processing*, doi.org/10.1007/s11760-018-1294-9.
4. Navid Razmjoo, Fatima Rashid Sheykhahmad, Noradin Ghadimi. A hybrid neural network – world cup optimization algorithm for melanoma detection. *Open Medicine*. DOI: <https://doi.org/10.1515/med-2018-0002>. (ISI:IF:0.28)
5. Razmjoo, N., and M. Ramezani. "Solution of the Hamilton jacobi bellman uncertainties by the interval version of adomian decomposition method." *Int Rob Auto J* 4, no. 2 (2018): 113-117.
6. Razmjoo, Navid, and Mehdi Ramezani. "Uncertain Method for Optimal Control Problems With Uncertainties Using Chebyshev Inclusion Functions." *Asian Journal of Control* (2019). (ISI,Q1)
7. Razmjoo, Navid, and Mehdi Ramezani. "Optimal Control of Two-Wheeled Self-Balancing Robot with Interval Uncertainties Using Chebyshev Inclusion Method." *Majlesi Journal of Electrical Engineering* 12, no. 1 (2018): 13-21. (SCOPUS, ISC)
8. Razmjoo, N., & Ramezani, M. (2017). Analytical solution for optimal control by the second kind Chebyshev polynomials expansion. *Iranian Journal of Science and Technology, Transactions A: Science*, 41(4), 1017-1026.
9. Navid Razmjoo, Mohsen Khalilpour, Mehdi Ramezani, "A New Meta-Heuristic Optimization Algorithm Inspired by FIFA World Cup Competitions: Theory and Its Application in PID Designing for AVR System", *J Control Autom Electr Syst*, DOI 10.1007/s40313-016-0242-6, Vol. 27, Issue 4, pp 419-440, 2016.
10. Navid Razmjoo and Mehdi Ramezani, "An Improved Quantum Evolutionary Algorithm Based on Invasive Weed Optimization", *Indian J.Sci.Res.*4 (2): 413-422, 2014.

11. Navid Razmjooya, B. Somayeh Mousavib, F. Soleymani, "A real-time mathematical computer method for potato inspection using machine vision", *Computers and Mathematics with Applications* 63, pp. 268–279, 2012
12. N. Razmjooy, B. Somayeh Mousavi, P. Sargolzaei, F. Soleymani, "Image thresholding based on evolutionary algorithms", *International Journal of the Physical Sciences*, Vol. 6(31), pp. 7203 - 7211, 30 November, 2011.
13. Payman Moallem; Navid Razmjooy; Bibi Somayeh Mousavi, " Robust Potato Color Image Segmentation using Adaptive Fuzzy Inference System", *Iranian Journal of Fuzzy Systems*, Articles in Press Available Online from 20 August 2014.
14. B. Somayeh Mousavi, P. Sargolzaei, Navid Razmjooy, V. Hosseinabadi, F. Soleymani, "Digital Image Segmentation Using Rule-Base Classifier", *American Journal of Scientific Researches*, Issue 35, pp.17-23, 2011. (*ISI Listed Journal*).
15. Payman Moallem, Navid Razmjooy, "A Multi Layer Perceptron Neural Network Trained by Invasive Weed Optimization for Potato Color Image Segmentation", *Trends in Applied Sciences Research*, vol7, pp. 38374-38374, 2012 (*ISI Journal, IF: 0.45*).
16. Navid Razmjooy, B. Somayeh Mousavi, Mohsen Khalilpour, Hossein Hosseini, "Automatic selection and fusion of color spaces for image thresholding", *Signal, Image and Video Processing*, Vol.1 (1), pp.1-12, DOI 10.1007/s11760-012-0303-7.
17. B. Somayeh Mousavi, Fazlollah Soleymani, Navid Razmjooy, "Color image segmentation using neuro fuzzy system in a novel optimized color space", *Neural Comput & Applic*, DOI 10.1007/s00521-012-1102-3 .
18. B. Somayeh Mousavi, Fazlollah Soleymani, Navid Razmjooy, "Semantic image classification by genetic algorithm using optimised fuzzy system based on Zernike moments", *Signal, Image and Video Processing*, DOI 10.1007/s11760-012-0311-7 .
19. Payman Moallem, Navid Razmjooy and Mohsen Ashourian, "Computer vision-based potato defect detection using neural networks and support vector machines", *International Journal of Robotics and Automation*, Vol. 28, No. 2, 2013.
20. P. Moallem, N. Razmjooy, "Optimal threshold computing in automatic image thresholding using adaptive particle swarm optimization", *Journal of Applied Research and Technology*, vol.10, pp.703-712, Oct.2012.
21. H. Hosseini, M. Farsadi, A. Lak, H. Ghahramani, N. Razmjooy, "A novel method using imperialist competitive algorithm (ICA) for controlling pitch angle in hybrid wind and PV array energy production system", *International Journal on Technical and Physical Problems of Engineering*, vol.4, no.2, pp.145-152, 2012.
22. M. Khalilpour, N. Razmjooy, A. Danandeh, M. Rostamzadeh, "Optimal Bidding Strategy in Power Market before and after Congestion Management using Invasive Weed Optimization", *Research Journal of Applied Sciences, Engineering and Technology*, vol. 5, no, 4, pp. 130-1338, 2013.
23. M. Khalilpour, Kh. Valipour, H. Shayeghi, N. Razmjooy, "Designing a Robust and Adaptive PID Controller for Gas Turbine Connected to the Generator", *Research Journal of Applied Sciences, Engineering and Technology*, Vol. 5(5), pp. 1543-1551, 2013.
24. M. Rostamzadeh, K. Valipour, J. Shenava, M. Khalilpour, N. Razmjooy, "Optimal Location and Capacity of multi-Distributed Generation for Loss Reduction and Voltage Profile Improvement Using Imperialist Competitive Algorithm", *Artificial Intelligence Research*, vol.1n2, pp.56, DOI: 10.5430/air.
25. Razmjooy, Navid, B. Somayeh Mousavi, Fazlollah Soleymani, and M. Hosseini Khotbesara. "A computer-aided diagnosis system for malignant melanomas." *Neural Computing and Applications* 23, no. 7-8 (2013): 2059-2071.
26. Navid Razmjooy, B. Somayeh Mousavi, F. Soleymani "A Hybrid Neural Network-Imperialist Competitive Algorithm for Skin Color Segmentation", *Mathematical and Computer Modelling*, vol. 57, pp.848–856, 2013.
27. M. Khalilpour, N. Razmjooy, "Congestion Management Role in Optimal Bidding Strategy using Imperialist Competitive Algorithm", *majlesi journal of energy management*, Vol.1 (2), 2012.
28. Hossein Hosseini, Morteza Farsadi, Mohsen Khalilpour, Navid Razmjooy, " Hybrid Energy Production System with PV Array and Wind Turbine and Pitch Angle Optimal Control by Genetic Algorithm (GA)", *Journal of World's Electrical Engineering and Technology*, Vol.1 (1), pp. 1-4, 2012.
29. Hossein Hosseini, Behrooz Tusi, Navid Razmjooy, Mohsen Khalilpour, " Optimum Design of PSS and SVC Controller for Damping Low Frequency Oscillation (LFO)", *Journal of World's Electrical Engineering and Technology*, Vol.1 (1), pp. 5-11, 2012.
30. Hosseini, Hossein, Behrooz Tusi, and Navid Razmjooy. "Application of fuzzy subtractive clustering for optimal transient performance of automatic generation control in restructured power system." *Journal of Intelligent & Fuzzy Systems* 26, no. 3 (2014): 1155-1166.

31. Hosseini, Hosssein, Behrooz Tousi, Navid Razmjooy, and Mohsen Khalilpour. "Design robust controller for automatic generation control in restructured power system by imperialist competitive algorithm." *IETE Journal of Research* 59, no. 6 (2013): 745-752.
32. Kamal Yavarian, Mohsen Khalilpour and Navid Razmjooy, "Transmission Line Congestion Management by Specifying Optimal Placement of FACTS Devices Using Artificial Bee Colony Optimization", *Research Journal of Applied Sciences, Engineering and Technology*, vol.6(23), pp. 4350-4357, 2013.
33. Mohsen Khalilpour and Navid Razmjooy, "A Hybrid Method for Gesture Recognition", *Journal of World's Electrical Engineering and Technology*, Vol.2 (3), 2013.
34. Navid Razmjooy, S. Shahram Naghibzadeh, bb. Somayeh Musavi, "Digital Red Eye Correction in Digital Photos" *International Journal of Computer Applications*, Vol. 95(9), 2014 .
35. Payman Moallem; Navid Razmjooy; Bibi Somayeh Mousavi, " Robust Potato Color Image Segmentation using Adaptive Fuzzy Inference System", *Iranian Journal of Fuzzy Systems*, Vol. 11, No. 6, pp. 47-65, 2014.
36. Razmjooy, Navid, Mehdi Ramezani, and Noradin Ghadimi. "Imperialist competitive algorithm-based optimization of neuro-fuzzy system parameters for automatic red-eye removal." *International Journal of Fuzzy Systems* 19, no. 4 (2017): 1144-1156.
37. Navid Razmjooy, Madadi A., Alikhani H., Mohseni M. "Comparison of LQR and Pole Placement Design Controllers for Controlling the Inverted Pendulum", *Journal of World's Electrical Engineering and Technology*, Vol.3 (2), 2014.
38. Maryam honarmand¹, Navid Razmjooy, Bibi Somayeh Moosavi, " Texture Classification Using Optimized Neural Networks Based on Firefly Algorithm", *Technical Journal of Engineering and Applied Sciences*, Vol. 4 (4), Pp. 485-492, 2014, 2014.
39. Navid Razmjooy, Mehdi Ramezani, "Using Quantum Gates to design a PID Controller for Nano robots", *International Research Journal of Applied and Basic Sciences*, Vol, 8 (12): 2354-2359, 2014
40. F. Ebrahiminezhad, N. Razmjooy, " An Intelligent-based Mechatronics System for Grading the Iranian's Export Pistachio Nuts into Hulled and Non-hulled Groups", *Indian J. Sci. Res* 7, no. 1 (2014): 1063-1071.
41. Navid Razmjooy , Mohsen Khalilpour, "A Robust Controller For Power System Stabilizer By Using Artificial Bee Colony Algorithm", *Tech J Engin & App Sci.*, vol.5, no.3, pp. 106-113, 2015
42. Navid Razmjooy , Mohsen Khalilpour, "Optimum Control of Hydro-Turbine Connected to the equivalent network for Damping Frequency Oscillation Using Invasive Weed Optimization (IWO) Algorithm", *Intl. Res. J. Appl. Basic. Sci. Vol.*, 9 (7), 1204-1211, 2015
43. Razmjooy N, Ramezani M, Nazari E. using Iqg/ltr optimal control method for car suspension system. *SCRO Annual Report Journal*. 2015 Feb 26;3.
44. Rashid Sheykhahmad, Fatima, Navid Razmjooy, and Mehdi Ramezani. "A Novel Method for Skin Lesion Segmentation." *International Journal of Information, Security and Systems Management* 4.2 (2015): 458-466.
45. Razmjooy, Navid, and Mohsen Khalilpour. "A new design for PID controller by considering the operating points changes in Hydro-Turbine Connected to the equivalent network by using Invasive Weed Optimization (IWO) Algorithm." *International Journal of Information, Security and Systems Management* 4.2 (2015): 468-475.
46. Navid Razmjooy and Mehdi Ramezani, "Training Wavelet Neural Networks Using Hybrid Particle Swarm Optimization and Gravitational Search Algorithm for System Identification", *International Journal of Mechatronics, Electrical and Computer Technology*, Vol. 6(21), Jul. 2016, PP. 2987-2997.
47. N. Razmjooy, M. Ramezani, A. Namadchian, "A New LQR Optimal Control for a Single-Link Flexible Joint Robot Manipulator Based on Grey Wolf Optimizer", *Majlesi Journal of Electrical Engineering*, Vol. 10, No. 3, September 2016, 53-60.
48. A. Namadchian, M. Ramezani, N. Razmjooy, "A New Meta-Heuristic Algorithm for Optimization based on Variance Reduction of Guassian Distribution", *Majlesi Journal of Electrical Engineering*, Vol. 10, No. 4, Dec.2016, 49-56.
49. Razmjooy, Navid, Ali Madadi, and Mehdi Ramezani. "Robust Control of Power System Stabilizer Using World Cup Optimization Algorithm.", *International Journal of Information, Security, and Systems Management* (2016), 5(1), pp. 524-531,
50. do Nascimento, D. A., Iano, Y., Loschi, H. J., Razmjooy, N., Sroufe, R., Oliveira, V. D. J. S., ... & Montagner, M. (2019). Sustainable Adoption of Connected Vehicles in the Brazilian Landscape: Policies, Technical Specifications and Challenges. *Transactions on Environment and Electrical Engineering*, 3(1), 44-62.

51. Monteiro, A. C. B., França, R. P., Estrela, V. V., Iano, Y., Khelassi, A., & Razmjooy, N. Health 4.0 as an Application of Industry 4.0 in Healthcare Services and Management. Vol 2 (4), Medical technologies journal, 2019.
52. Abedinia, Oveis, Nima Amjady, and Ali Ghasemi. "A new metaheuristic algorithm based on shark smell optimization." *Complexity* 21.5 (2016): 97-116.
53. Abedinia, Oveis, et al. "Solution of economic load dispatch problem via hybrid particle swarm optimization with time-varying acceleration coefficients and bacteria foraging algorithm techniques." *International Transactions on Electrical Energy Systems* 23.8 (2013): 1504-1522.
54. Abedinia, Oveis, Bart Wyns, and Ali Ghasemi. "Robust fuzzy PSS design using ABC." *Environment and Electrical Engineering (EEEIC), 2011 10th International Conference on*. IEEE, 2011.
55. Abedinia, Oveis, Nima Amjady, and Hamidreza Zareipour. "A new feature selection technique for load and price forecast of electrical power systems." *IEEE Transactions on Power Systems* 32.1 (2017): 62-74.
56. Abedinia, Oveis, and Nima Amjady. "Short-term wind power prediction based on Hybrid Neural Network and chaotic shark smell optimization." *international journal of precision engineering and manufacturing-green technology* 2.3 (2015): 245-254.
57. Shayanfar, Heidar Ali, et al. "Design Rule-Base of Fuzzy Controller in Multimachine Power System Stabilizer Using Genetic Algorithm." *IC-AI*. 2010.
58. Abedinia, Oveis, and Nima Amjady. "Short-term load forecast of electrical power system by radial basis function neural network and new stochastic search algorithm." *International transactions on electrical energy systems* 26.7 (2016): 1511-1525.
59. Abedinia, Oveis, Ali Ghasemi, and Nasser Ojaroudi. "Improved time varying inertia weight PSO for solved economic load dispatch with subsidies and wind power effects." *Complexity* 21.4 (2016): 40-49.
60. Abedinia, Oveis, et al. "Design of robust PSS to improve stability of composed LFC and AVR using ABC in deregulated environment." *13th International conference on Artificial Intelligence (ICAI 2011)*. 2011.
61. Amjady, Nima, and Oveis Abedinia. "Short term wind power prediction based on improved Kriging interpolation, empirical mode decomposition, and closed-loop forecasting engine." *Sustainability* 9.11 (2017): 2104.
62. Abedinia, Oveis, Morteza Dadash Naslian, and Masoud Bekravi. "A new stochastic search algorithm bundled honeybee mating for solving optimization problems." *Neural Computing and Applications* 25.7-8 (2014): 1921-1939.
63. Armaghani, Saber, Nima Amjady, and Oveis Abedinia. "Security constrained multi-period optimal power flow by a new enhanced artificial bee colony." *Applied Soft Computing* 37 (2015): 382-395.
64. Abedinia, Oveis, and Ebrahim S. Barazandeh. "Interactive Artificial Bee Colony based on distribution planning with renewable energy units." *Innovative Smart Grid Technologies (ISGT), 2013 IEEE PES*. IEEE, 2013.
65. Abedinia, O., N. Amjady, and Mohammad S. Naderi. "Multi-objective environmental/economic dispatch using firefly technique." *Environment and Electrical Engineering (EEEIC), 2012 11th International Conference on*. IEEE, 2012.
66. Abedinia, Oveis, and Nima Amjady. "Net demand prediction for power systems by a new neural network-based forecasting engine." *Complexity* 21.S2 (2016): 296-308.
67. Tohidi, Akbar, et al. "Experimental study of a disturbance rejection controller for dfig based wind energy conversion systems." *ASME 2014 Dynamic Systems and Control Conference*. American Society of Mechanical Engineers, 2014.
68. Abedinia, Oveis, and Nima Amjady. "Day-ahead price forecasting of electricity markets by a new hybrid forecast method." *Modeling and Simulation in Electrical and Electronics Engineering* 1.1 (2015): 1-7.
69. Abedinia, Oveis, David Raisz, and Nima Amjady. "Effective prediction model for Hungarian small-scale solar power output." *IET Renewable Power Generation* 11.13 (2017): 1648-1658.
70. Abedinia, O., et al. "Multiobjective environmental and economic dispatch using imperialist competitive algorithm." *International Journal on Technical and Physical Problems of Engineering (IJTPE)* 11 (2012): 63-70.
71. Ghasemi, A., et al. "Optimal placement and tuning of robust multimachine PSS via HBMO." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2011.
72. Abedinia, O., Mohammad S. Naderi, and A. Ghasemi. "Robust LFC in deregulated environment: Fuzzy PID using HBMO." *Environment and Electrical Engineering (EEEIC), 2011 10th International Conference on*. IEEE, 2011.

73. Abedinia, O., et al. "Multi-machine power system oscillation damping: Placement and tuning PSS VIA multi-objective HBMO." *International Journal of Technical and Physical Problems of Engineering* 4.3 (2012): 12.
74. Shayanfar, H. A., et al. "PSO-IIW for Combined Heat and Power Economic Dispatch." *International Journal on Technical and Physical Problems of Engineering (IJTPE)* 4.11 (2012): 51-55.
75. Ghasemi, A., et al. "PSO-TVAC Algorithm for Multi Objective PSS Design in Multi-Machine Power System." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2011.
76. Abedinia, O., et al. "Fuzzy PID based on firefly algorithm: load frequency control in deregulated environment." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2012.
77. Shayanfar, H. A., et al. "Optimal PID power system stabilizer tuning via artificial bee colony." *Technical and Physical Problems of Engineering (IJTPE)* 12 (2012): 75-82.
78. Tohidi, Akbar, et al. "Multivariable adaptive variable structure disturbance rejection control for DFIG system." *Complexity* 21.4 (2016): 50-62.
79. Abedinia, O., et al. "Optimal congest management based VEPSO an electricity market." *Int J Tech Phys Probl Eng* 4.2 (2012): 56-62.
80. Shayanfar, H. A., et al. "Solving optimal unit commitment by improved honey bee mating optimization." *International Journal on Technical and Physical Problems of Engineering (IJTPE)* 4 (2012): 38-45.
81. Abedinia, O., et al. "Modified invasive weed optimization based on fuzzy PSS in multi-machine power system." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2012.
82. Shayanfar, H. A., et al. "GSA to tune fuzzy controller for damping power system oscillation." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2011.
83. Abedinia, O., N. Amjady, and Mohammad S. Naderi. "Multi-stage Fuzzy PID Load Frequency Control via SPHBMO in deregulated environment." *Environment and Electrical Engineering (EEEIC), 2012 11th International Conference on*. IEEE, 2012.
84. Shayeghi, H., et al. "Optimal thermal generating unit commitment with wind power impact: a PSO-IIW procedure." *International Journal on Technical and Physical Problems of Engineering (IJTPE)* 4.2 (2012): 90-97.
85. Bipirayeh, K., O. Abedinia, and H. A. Shayanfar. "Optimal Multi-Stage Fuzzy PID Bundled PSOTVAC in Multimachine Environment." *International Journal on Technical and Physical Problems of Engineering (IJTPE)* 14: 37-43.
86. Shayanfar, H. A., et al. "Economic load dispatch using strength pareto gravitational search algorithm with valve point effect." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2012.
87. Shayanfar, H. A., et al. "Wind power prediction model based on hybrid strategy." *Proceedings of the International Conference on Scientific Computing (CSC)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2016.
88. Amjady, N., et al. "Market Optimization Using Fuzzy Based Multiobjective Harmony Search Algorithm." *International Journal on Technical and Physical Problems of Engineering (IJTPE)* 12: 9-15.
89. Bekravi, M., and O. Abedinia. "A new multi-objective meta heuristic algorithm based on environmental/economic load dispatch with wind effect." *Technical and Physical Problems of Engineering* 5.2 (2013): 15.
90. Abedinia, O., N. Amjady, and Mohammad S. Naderi. "Optimal congestion management in an electricity market using Modified Invasive Weed Optimization." *Environment and Electrical Engineering (EEEIC), 2012 11th International Conference on*. IEEE, 2012.
91. Duan, Min, et al. "A novel hybrid prediction model for aggregated loads of buildings by considering the electric vehicles." *Sustainable Cities and Society* 41 (2018): 205-219.
92. Abedinia, Oveis, and Nima Amjady. "Optimal Distribution of Reactive Power based on Shark Smell Optimization with Pareto Criterion in Power System." (2016): 133-144.
93. Bagheri, Mehdi, et al. "Enhancing Power Quality in Microgrids With a New Online Control Strategy for DSTATCOM Using Reinforcement Learning Algorithm." *IEEE Access* 6 (2018): 38986-38996.

94. Bagheri, Mehdi, et al. "Direct and Indirect Prediction of Net Demand in Power Systems Based on Syntactic Forecast Engine." *2018 IEEE International Conference on Environment and Electrical Engineering and 2018 IEEE Industrial and Commercial Power Systems Europe (EEEIC/I&CPS Europe)*. IEEE, 2018.
95. Kuspan, Bekarys, et al. "The Influence of Electric Vehicle Penetration on Distribution Transformer Ageing Rate and Performance." *2018 7th International Conference on Renewable Energy Research and Applications (ICRERA)*. IEEE, 2018.
96. Mussin, Nauryzbay, et al. "Transformer Active Part Fault Assessment Using Internet of Things." *2018 International Conference on Computing and Network Communications (CoCoNet)*. IEEE, 2018.
97. Shayanfar, H. A., et al. "Optimal Sizing and Placement of Distribution Generation Using Imperialist Competitive Algorithm." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2012.
98. Abedinia, O., N. Amjady, and H. A. Shayanfar. "Generation Expansion Planning base on Modified Shuffled Frog Leaping in Restructured Environment." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2013.
99. Shayanfar, H. A., O. Abedinia, and N. Amjady. "Distribution Planning with Renewable Energy Units based on Modified Shuffled Frog Leaping Algorithm." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2013.
100. Abedinia, O., N. Amjady, and H. A. Shayanfar. "A Hybrid Artificial Neural Network and VEPSO based on Day-ahead Price Forecasting of Electricity Markets." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2014.
101. Shayanfar, H. A., O. Abedinia, and N. Amjady. "Optimal Damping of Oscillation in Multi-machine Power System by Renewable Energy Effects." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2014.
102. Shayanfar, H. A., et al. "Optimal Placement of Wind Turbines: Improved Honey Bee Mating Optimization." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2013.
103. Shayanfar, H. A., O. Abedinia, and N. Amjady. "Solving Unit Commitment Problem Based on New Stochastic Search Algorithm." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2015.
104. Yosefi, A., et al. "Design Robust PID Controller for Hydro-turbine governing with ABC Algorithm." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2012.
105. Abedinia, O., N. Amjady, and H. A. Shayanfar. "Optimal Design of SVC and Thyristor-Controlled Series Compensation Controller in Power System." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2015.
106. Shayanfar, H. A., et al. "Improved ABC and Fuzzy Controller Based on Consonant FACTS Devices." *Proceedings on the International Conference on Artificial Intelligence (ICAI)*. The Steering Committee of The World Congress in Computer Science, Computer Engineering and Applied Computing (WorldComp), 2016.